

# 9555P

Variable Orifice Cast Iron Double Regulating Valve



Via Circonvallazione, 10  
13018 Valduggia (VC), Italy  
Tel: +39 0163 47891  
Fax: +39 0163 47895  
www.vironline.com



Variable orifice cast iron double regulating valve  
Flanged PN16 according to EN1092-2 (ex DIN2533)  
Lengths according to EN558-1 series 1 (ex DIN3202 F1)  
Alkyd/acrylic single layer waterpaint coating (50-100µm)  
Tolerance on nominal  $K_v$  for completely open valve  $\pm 5\%$   
With plugged threaded drains ( $\frac{1}{4}$ " ISO 7/1Rp) for test points  
Provided with test points (given unmounted)  
TR CU 010 compliant

PN16

Free of CE marking for DN $\leq$ 300 (cat. according to Art. 4.3 Dir. 2014/68/EU)


Working conditions

- Suitable for: water,  $-10^{\circ}\text{C}$  to  $+110^{\circ}\text{C}$   
below  $0^{\circ}\text{C}$  only for water with added antifreeze fluids  
over  $100^{\circ}\text{C}$  only for water with added anti-boiling fluids  
(ethylene glycol or propylene glycol mixtures up to 50% may be used)
- Not suitable for: gases group 1 & 2, liquids group 1 (Dir. 2014/68/EU)



## PARTLIST

N.	Part	Material	Norm
1	Body	Cast iron <sup>1</sup>	EN-GJL-250 JL1040
2	Cone screw <sup>2</sup>	Stainless steel	A2
3	Balancing cone	Composite material <sup>1</sup>	-
4	Gasket disc	EPDM	-
5	Shutter	Composite material <sup>1</sup>	-
6	Shut./bon. O-ring	EPDM	-
7	Body/bon. O-ring	EPDM	-
8	Bonnet <sup>3</sup>	Cast iron	EN-GJL-250 JL1040
9	Screws <sup>2</sup>	Carbon steel	8.8 A2A
10	Memory stop	DZR Brass	EN12164 CW602N
11	Mem. stop O-ring	EPDM Perox	-
12	Washer <sup>2</sup>	DZR Brass	EN12164 CW602N
13	Stem	DZR Brass	EN12164 CW602N
14	Stem O-ring <sup>2</sup>	EPDM	-
15	Screw <sup>2</sup>	Brass <sup>4</sup>	CW508L
16	Bushing O-ring <sup>2</sup>	EPDM	-
17	Bushing	DZR Brass <sup>5</sup>	EN12164 CW602N
18	Handwheel	Polyamide <sup>6</sup>	PA6.6
19	Handwheel screw	Brass <sup>7</sup>	CW508L
20	Handwheel cap	Polyamide	PA6.6
21	Plug	Steel <sup>8</sup>	C35E
22	Test point	DZR Brass <sup>9</sup>	EN12164 CW602N

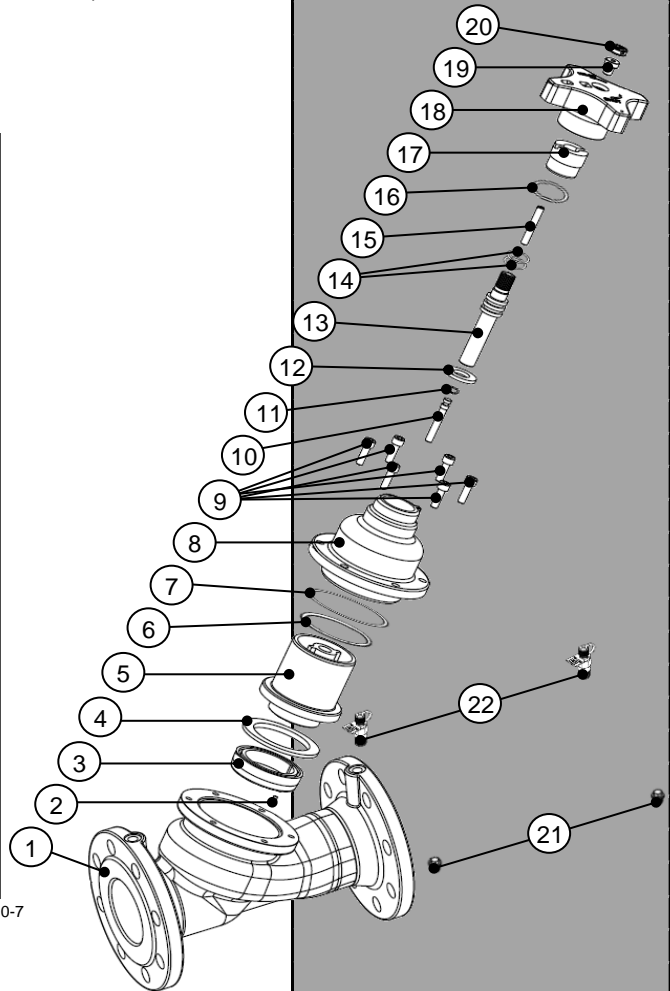

<sup>1</sup>For DN350 and DN400 d.i. EN-GJS-400-18-LT, shutter with guides in bronze and cone in d.i. EN-GJS-500-7

<sup>2</sup>DN40-DN50 excluded

<sup>3</sup>Screwed bonnet in CW602N for DN40-DN50

Two-pieces bonnet (screwed) with EPDM gasket for DN65

Two-pieces bonnet with bottom part in ductile iron EN-GJS-500-7 JL1050 and 8.8 A2A steel joint screws for DN200-DN300

Two-pieces bonnet in ductile iron EN-GJS-400-18-LT and 8.8 A2A steel joint screws for DN350-DN400

<sup>4</sup>X5CrNi18-10 steel for DN $\geq$ 200

<sup>5</sup>Copper nut and steel ring for DN40-DN50

<sup>6</sup>CuZn40Pb2 brass screw and washer for DN $\geq$ 200

<sup>7</sup>5 A2A steel for DN $\geq$ 200

<sup>8</sup>Caps with carbamide rubber gaskets

<sup>9</sup>Test points with EPDM gaskets and polypropylene ties


210125

# DIMENSIONS

DN	ØF [mm]	ØE [mm]	NxØD [mm]	L [mm]	H [mm]	ØV [mm]	Weight [kg]	Flow range [l/s]
040	150	110	4x19	200	130	74	6,1	0,81-1,88 <sup>1</sup>
050	165	125	4x19	230	130	74	8,3	1,52-3,51 <sup>1</sup>
065	185	145	4x19	290	220	130	13,5	3,02-6,95 <sup>1</sup>
080	200	160	8x19	310	220	130	17,8	6,40-15,36 <sup>1</sup>
100	220	180	8x19	350	240	130	22,7	10,85-26,04 <sup>1</sup>
125	250	210	8x19	400	260	130	34,0	16,85-39,75 <sup>1</sup>
150	285	240	8x23	480	285	130	48,5	23,71-56,91 <sup>1</sup>
200	340	295	12x23	600	480	310	114,5	41,86-100,47 <sup>1</sup>
250	405	355	12x28	730	525	310	159,0	66,58-156,78 <sup>1</sup>
300	460	410	12x28	850	535	310	210,5	94,16-255,99 <sup>1</sup>
350	520	470	16x28	980	650	350	375,0	96-261
400	580	525	16x31	1100	750	350	510,0	117-320

<sup>1</sup>Suggested flow range applicability (BS7350)

If used with measuring manometers different from those proposed by VIR please verify that sensibility of the measuring device is compatible with indicated minimum flow (see flow measurement paragraph)


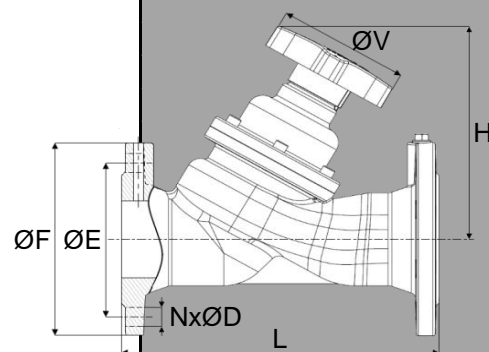


# FLOW MEASUREMENT

$$Q = \frac{K_v \cdot \sqrt{\Delta p^{TP}}}{36}$$


Formula linking flow Q (in l/s) and Δp measured at test points (in kPa). K<sub>v</sub> depends on handwheel position as indicated on table in the next page. Minimum flow that can be measured for each diameter may be calculated by using in the formula minimum Δp that can be measured by used manometer.

Valves are anyway designed for best performances when used on range previously suggested and as indicated by BS7350.





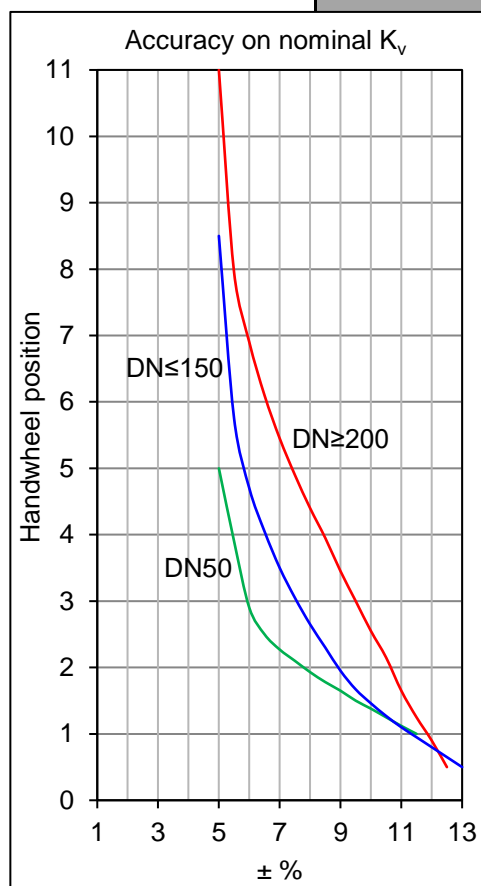
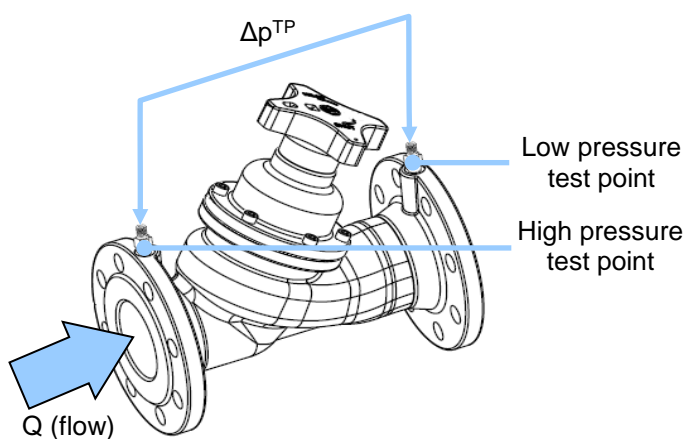


Via Circonvallazione, 10  
13018 Valduggia (VC), Italy  
Tel: +39 0163 47891  
Fax: +39 0163 47895  
www.vironline.com


Handwheel position	$K_v$ [m <sup>3</sup> /h @ 1bar]											
	040	050	065	080	100	125	150	200	250	300	350	400
1,0	4,5	3,7	21,9	7,9	9,6	13,0	14,8	38,6	62,3	57,1	-	-
1,5	6,2	5,2	26,4	9,9	12,8	17,8	19,1	45,6	73,1	72,2	-	-
2,0	8,6	8,9	31,1	11,8	16,6	23,7	29,7	54,6	87,3	89,8	-	-
2,5	11,4	13,6	35,7	13,8	22,9	33,1	51,8	71,2	115,8	110,2	-	-
3,0	13,8	17,6	40,1	16,7	34,0	51,2	83,7	99,9	163,9	140,7	152,3	153,1
3,5	16,7	21,9	44,4	21,9	50,5	77,0	132,0	148,6	239,2	202,0	-	-
4,0	19,2	25,5	49,3	31,2	71,4	106,5	183,7	216,2	345,3	331,7	260,0	220,0
4,5	21,2	29,0	53,2	45,9	90,9	135,7	219,5	283,9	451,4	500,2	-	-
5,0	22,4	32,2	57,5	65,0	107,4	160,9	247,1	341,2	543,3	634,1	400,2	455,2
5,5	-	-	64,4	79,5	121,6	182,1	273,3	387,7	622,0	733,2	-	-
6,0	-	-	71,8	89,3	135,0	201,9	298,2	430,1	694,0	825,1	670,1	724,4
6,5	-	-	76,6	96,6	148,1	221,6	321,3	471,7	765,2	922,9	-	-
7,0	-	-	80,4	102,7	159,9	239,8	342,2	507,6	823,7	1018	967,1	1090
7,5	-	-	84,1	108,2	169,8	255,9	360,7	535,2	876,3	1100	-	-
8,0	-	-	88,8	113,4	177,9	270,8	376,8	560,8	925,3	1170	1190	1398
8,5	-	-	-	-	184,7	285,1	390,2	590,0	974,4	1230	-	-
9,0	-	-	-	-	-	-	-	619,3	1022	1285	1344	1620
9,5	-	-	-	-	-	-	-	644,9	1068	1340	-	-
10,0	-	-	-	-	-	-	-	667,2	1110	1394	1490	1820
10,5	-	-	-	-	-	-	-	688,4	1150	1449	-	-
11,0	-	-	-	-	-	-	-	710,0	1188	1504	1610	2000
12,0	-	-	-	-	-	-	-	-	-	-	1712	2168
13,0	-	-	-	-	-	-	-	-	-	-	1810	2320
14,0	-	-	-	-	-	-	-	-	-	-	1910	2440
15,0	-	-	-	-	-	-	-	-	-	-	1992	2560
16,0	-	-	-	-	-	-	-	-	-	-	2070	2672
17,0	-	-	-	-	-	-	-	-	-	-	2140	2770
18,0	-	-	-	-	-	-	-	-	-	-	2215	2860
19,0	-	-	-	-	-	-	-	-	-	-	-	2950
20,0	-	-	-	-	-	-	-	-	-	-	-	3023
21,0	-	-	-	-	-	-	-	-	-	-	-	3090
22,0	-	-	-	-	-	-	-	-	-	-	-	3150
23,0	-	-	-	-	-	-	-	-	-	-	-	3200
24,0	-	-	-	-	-	-	-	-	-	-	-	3262

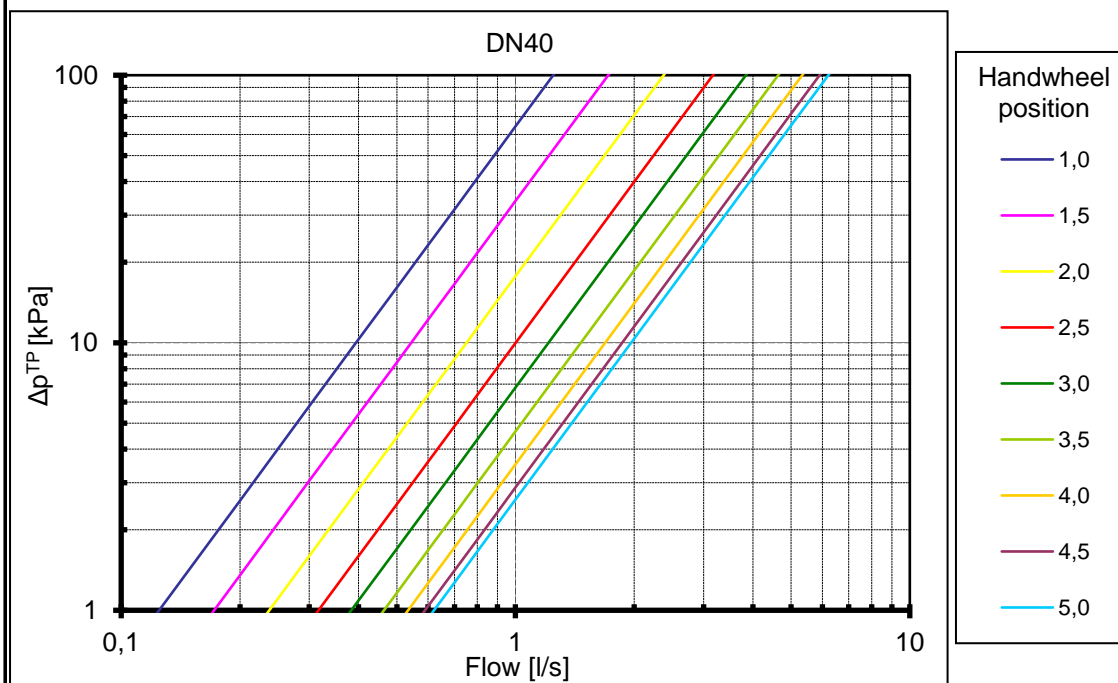


Via Circonvallazione, 10  
13018 Valduggia (VC), Italy  
Tel: +39 0163 47891  
Fax: +39 0163 47895  
www.vironline.com

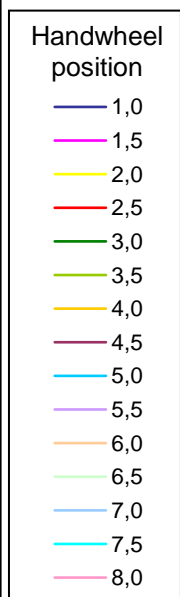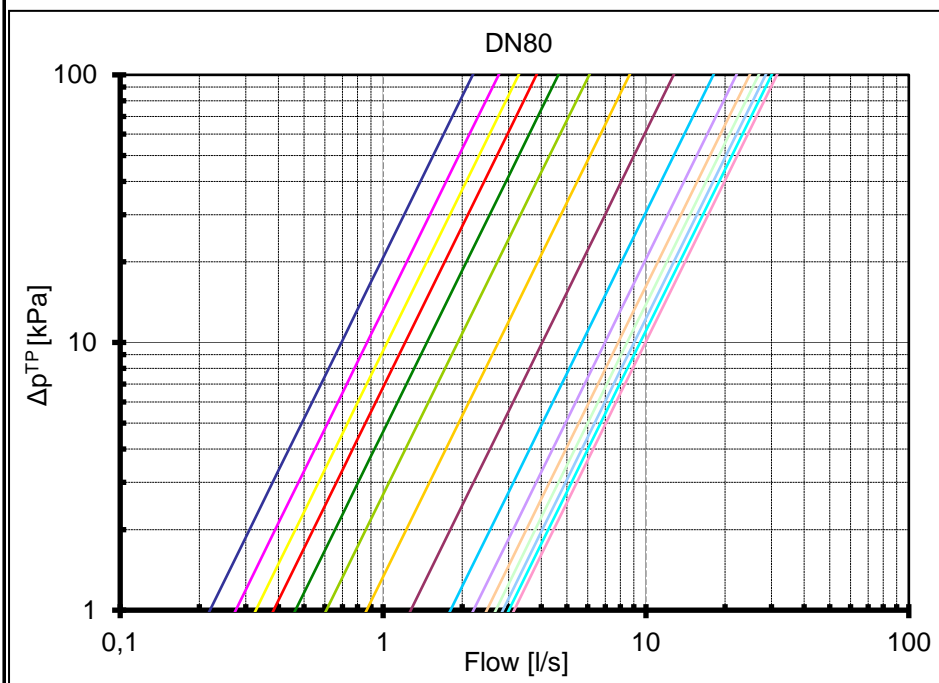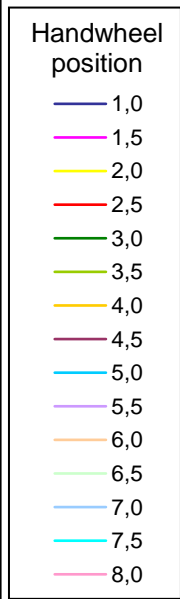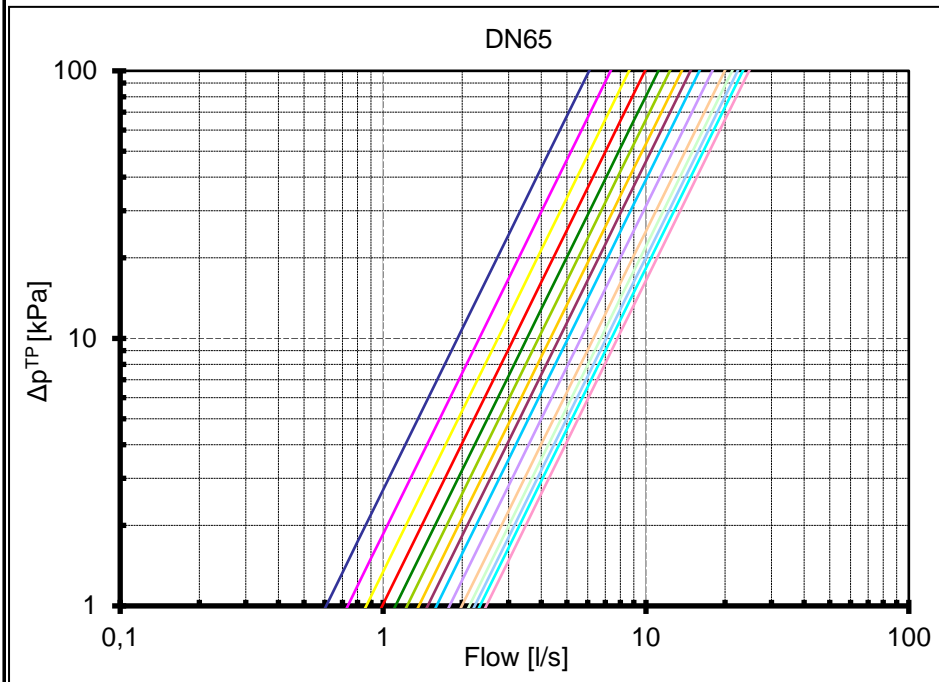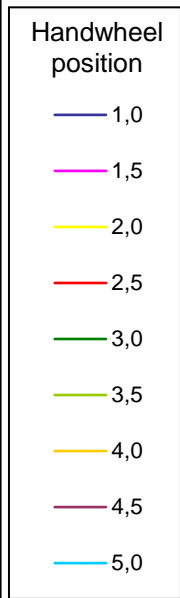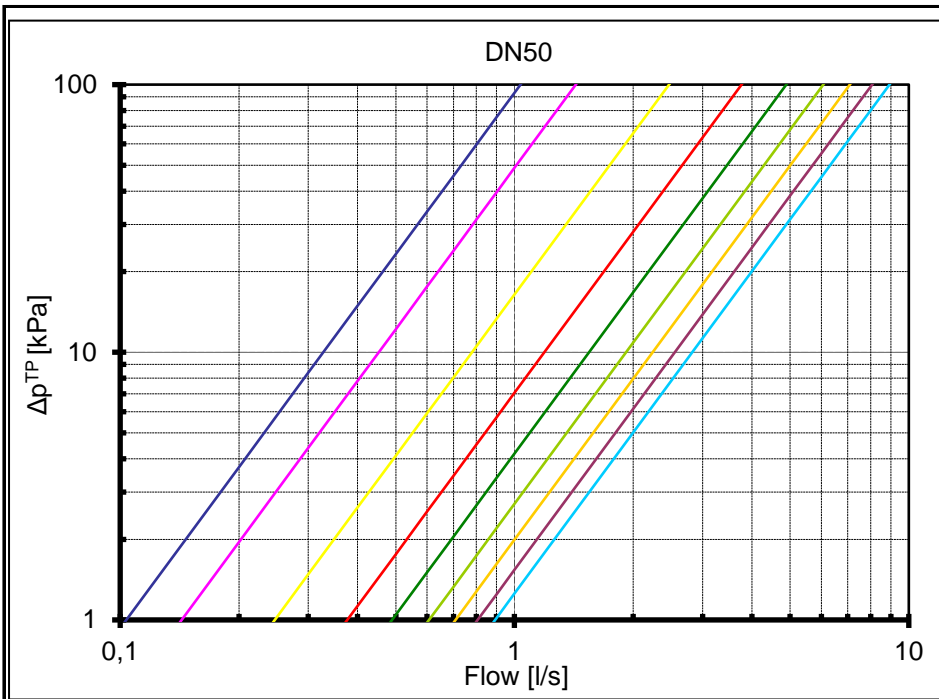


Via Circonvallazione, 10  
 13018 Valduggia (VC), Italy  
 Tel: +39 0163 47891  
 Fax: +39 0163 47895  
[www.vironline.com](http://www.vironline.com)

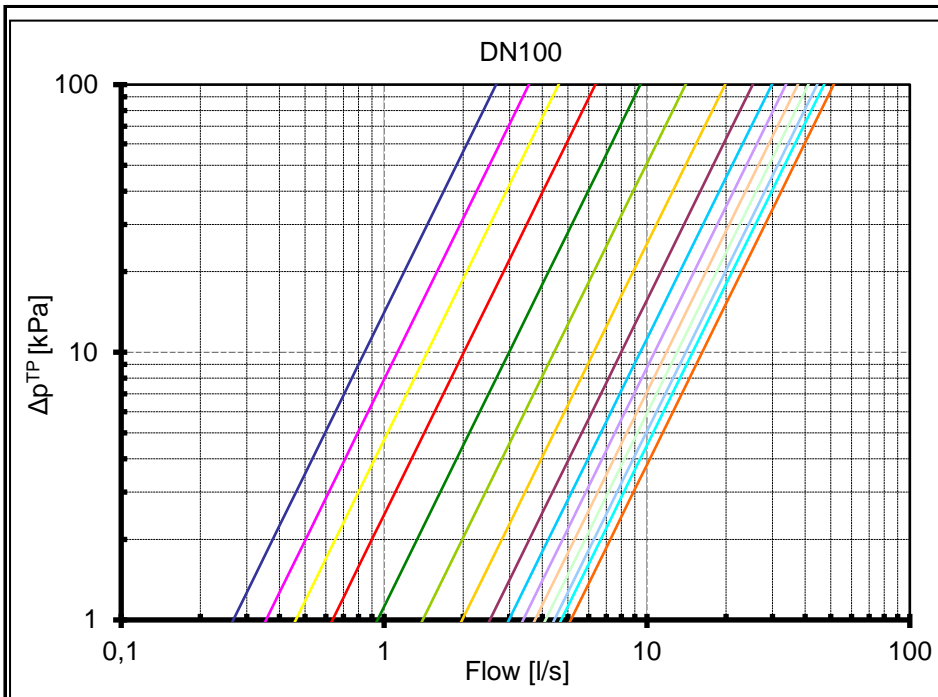

- Handwheel position
- 1,0
  - 1,5
  - 2,0
  - 2,5
  - 3,0
  - 3,5
  - 4,0
  - 4,5
  - 5,0
  - 5,5
  - 6,0
  - 6,5
  - 7,0
  - 7,5
  - 8,5

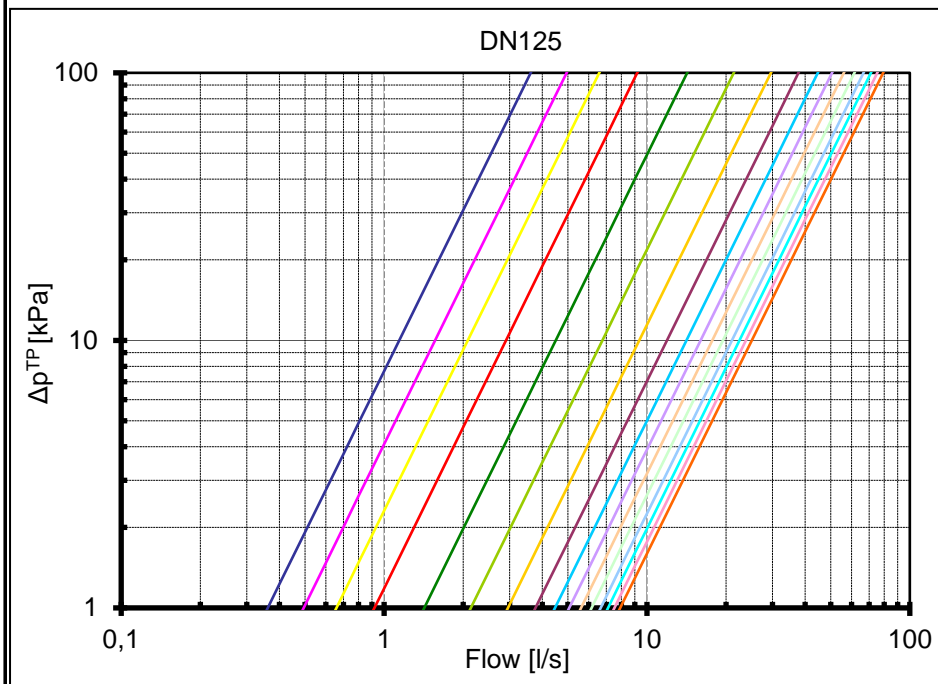


- Handwheel position
- 1,0
  - 1,5
  - 2,0
  - 2,5
  - 3,0
  - 3,5
  - 4,0
  - 4,5
  - 5,0
  - 5,5
  - 6,0
  - 6,5
  - 7,0
  - 7,5
  - 8,0
  - 8,5

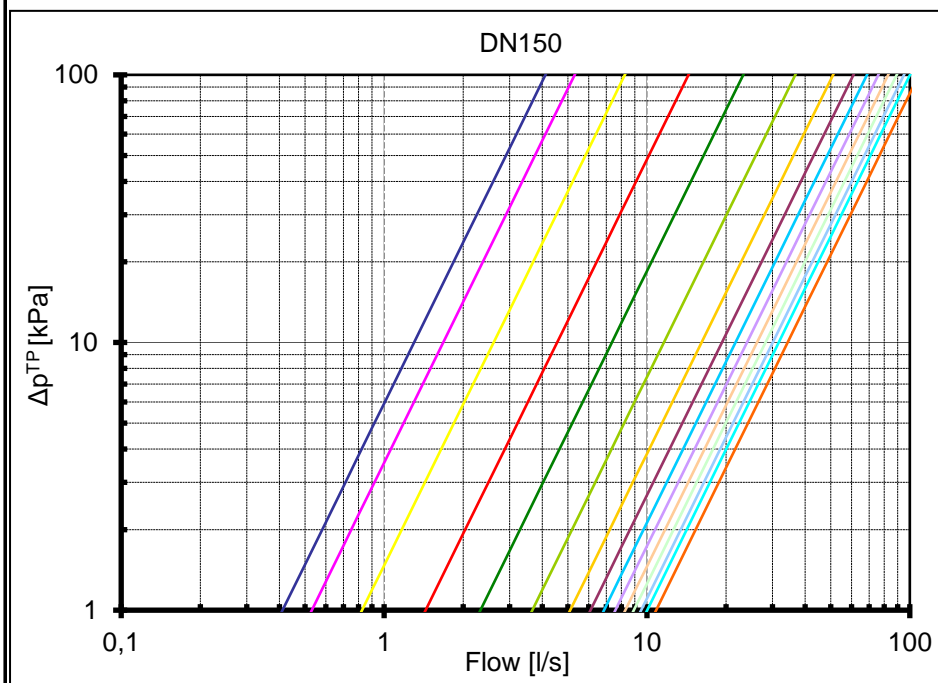


- Handwheel position
- 1,0
  - 1,5
  - 2,0
  - 2,5
  - 3,0
  - 3,5
  - 4,0
  - 4,5
  - 5,0
  - 5,5
  - 6,0
  - 6,5
  - 7,0
  - 7,5
  - 8,5




Via Circonvallazione, 10  
 13018 Valduggia (VC), Italy  
 Tel: +39 0163 47891  
 Fax: +39 0163 47895  
[www.vironline.com](http://www.vironline.com)

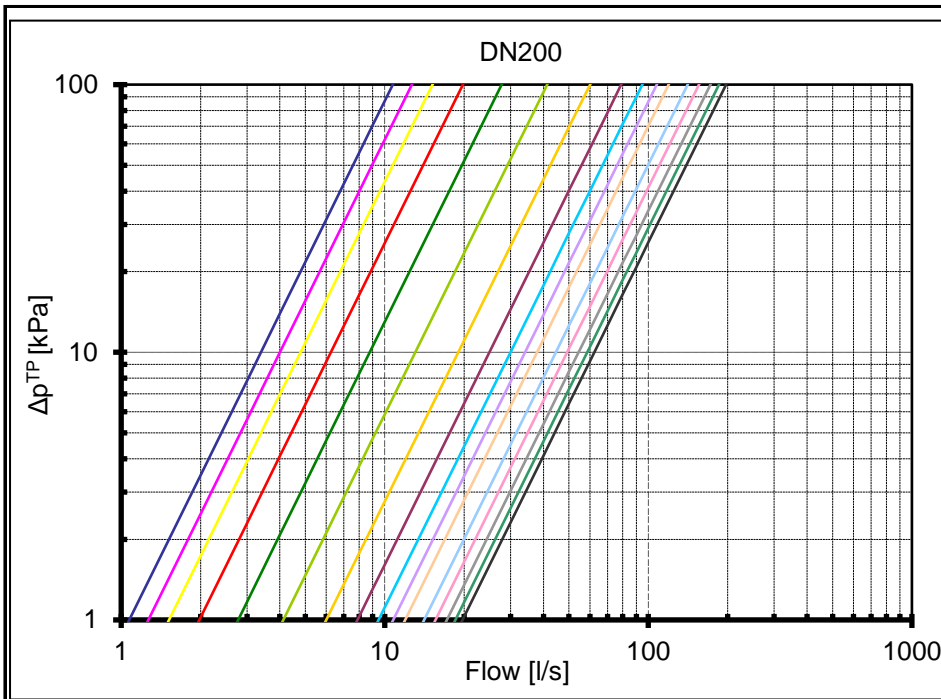

- Handwheel position
- 1,0
  - 1,5
  - 2,0
  - 2,5
  - 3,0
  - 3,5
  - 4,0
  - 4,5
  - 5,0
  - 5,5
  - 6,0
  - 7,0
  - 8,0
  - 9,0
  - 10,0
  - 11,0

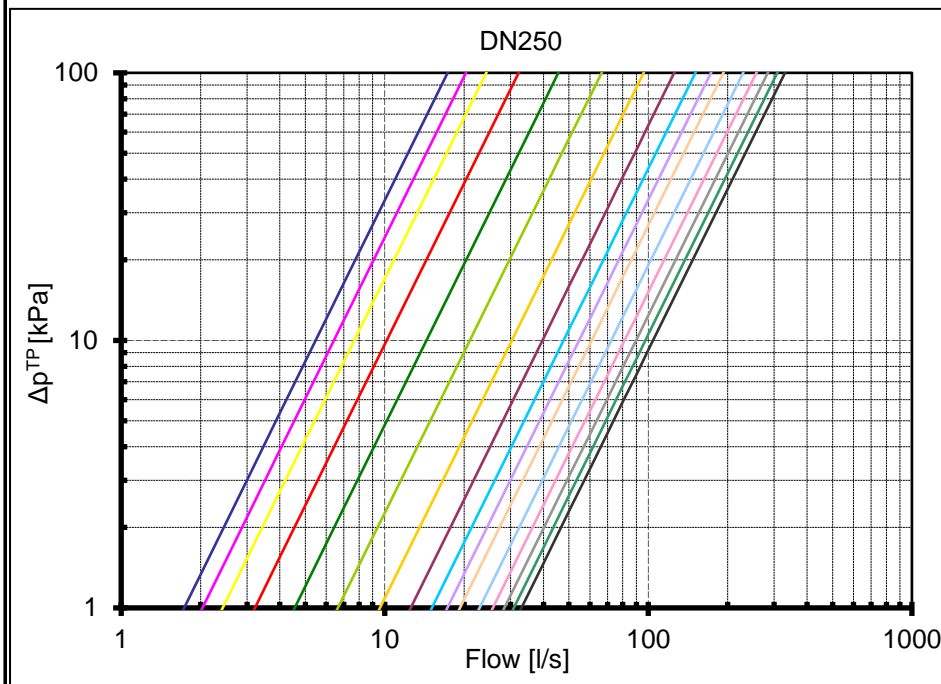


- Handwheel position
- 1,0
  - 1,5
  - 2,0
  - 2,5
  - 3,0
  - 3,5
  - 4,0
  - 4,5
  - 5,0
  - 5,5
  - 6,0
  - 7,0
  - 8,0
  - 9,0
  - 10,0
  - 11,0

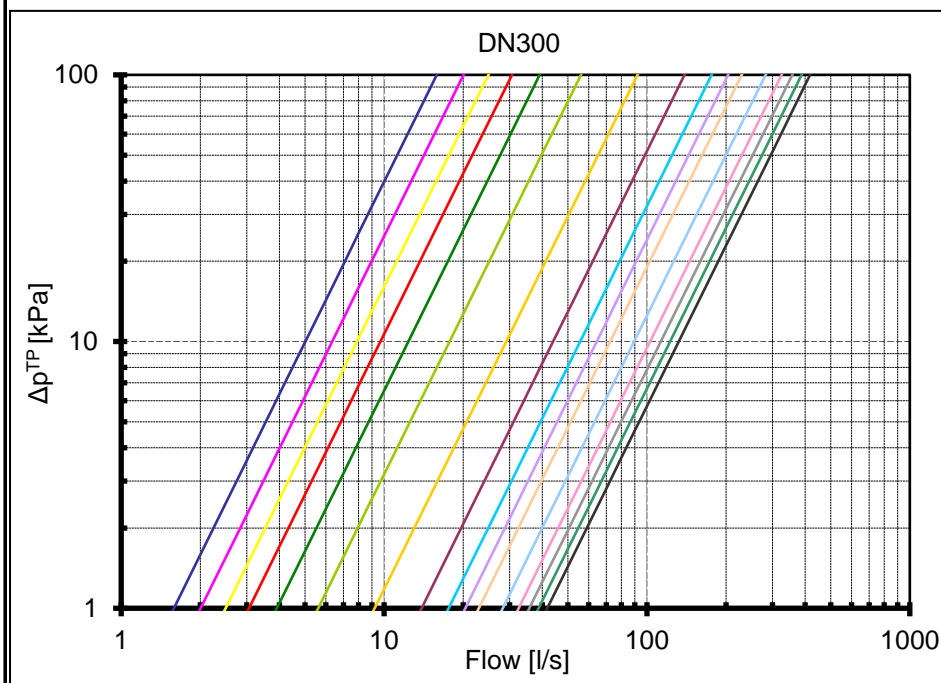

- Handwheel position
- 1,0
  - 1,5
  - 2,0
  - 2,5
  - 3,0
  - 3,5
  - 4,0
  - 4,5
  - 5,0
  - 5,5
  - 6,0
  - 7,0
  - 8,0
  - 9,0
  - 10,0
  - 11,0




Via Circonvallazione, 10  
 13018 Valduggia (VC), Italy  
 Tel: +39 0163 47891  
 Fax: +39 0163 47895  
[www.vironline.com](http://www.vironline.com)

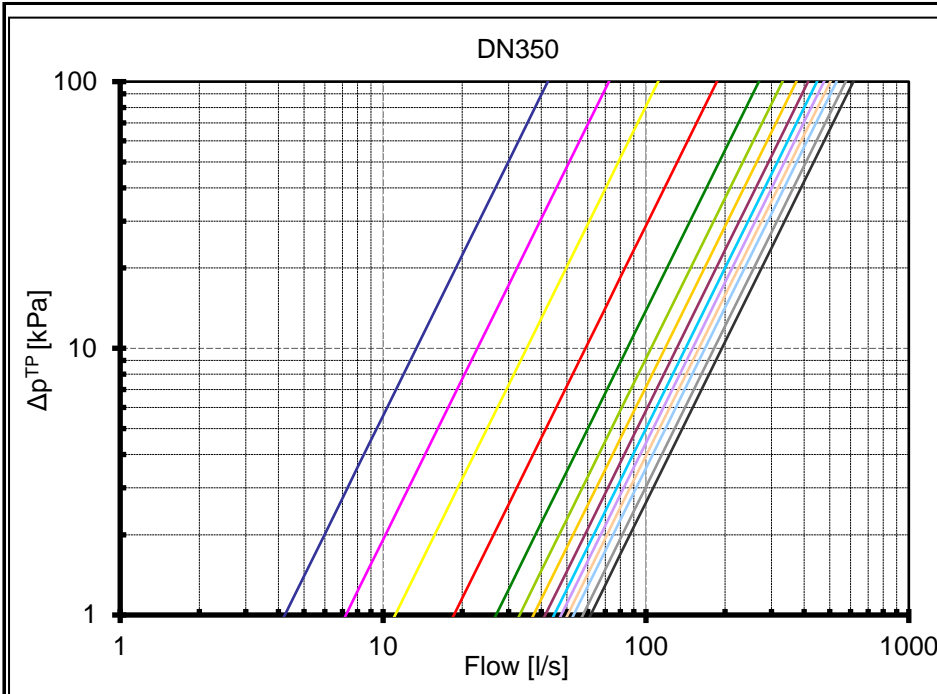

Handwheel position

- 3,0
- 4,0
- 5,0
- 6,0
- 7,0
- 8,0
- 9,0
- 10,0
- 11,0
- 12,0
- 13,0
- 14,0
- 16,0
- 18,0

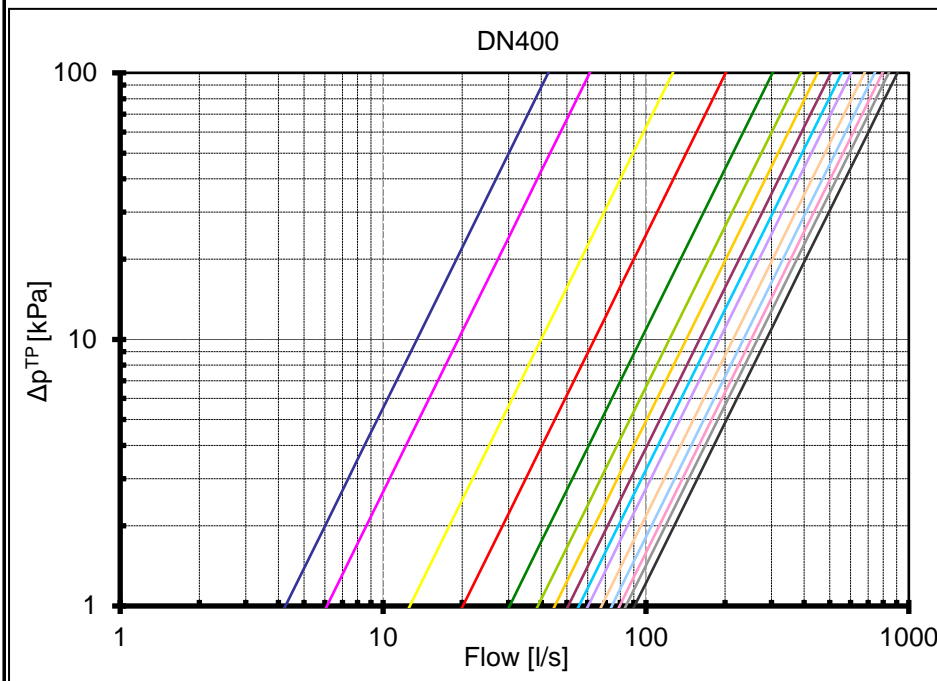


Handwheel position

- 3,0
- 4,0
- 5,0
- 6,0
- 7,0
- 8,0
- 9,0
- 10,0
- 11,0
- 12,0
- 14,0
- 16,0
- 18,0
- 20,0
- 24,0

## HEADLOSS CALCULATION

$$\Delta p = \left( \frac{36 \cdot Q}{K_v} \right)^2$$

Formula linking flow Q (in l/s) and theoretical valve headloss Δp (in kPa).  
K<sub>v</sub> depends on handwheel position as indicated on table in the next page.

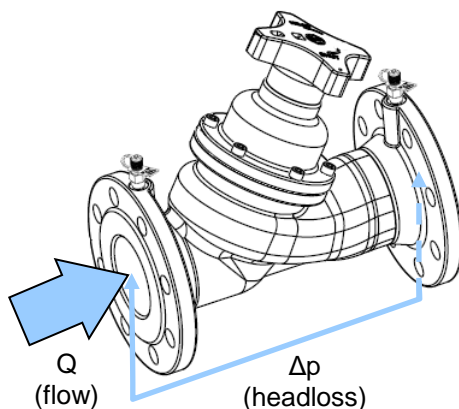


Via Circonvallazione, 10  
13018 Valduggia (VC), Italy  
Tel: +39 0163 47891  
Fax: +39 0163 47895  
[www.vironline.com](http://www.vironline.com)

Handwheel position	K <sub>v</sub> [m <sup>3</sup> /h @ 1bar]											
	040	050	065	080	100	125	150	200	250	300	350	400
1,0	4,5	3,7	21,9	7,9	9,6	13,0	14,8	38,6	62,3	57,1	-	-
1,5	6,2	5,2	26,4	9,9	12,8	17,8	19,1	45,6	73,1	72,2	-	-
2,0	8,6	8,9	31,1	11,8	16,6	23,7	29,7	54,6	87,3	89,8	-	-
2,5	11,4	13,6	35,7	13,8	22,9	33,1	51,8	71,2	115,8	110,2	-	-
3,0	13,8	17,6	40,1	16,7	34,0	51,2	83,7	99,9	163,9	140,7	152,3	153,1
3,5	16,7	21,9	44,4	21,9	50,5	77,0	132,0	148,6	239,2	202,0	-	-
4,0	19,2	25,5	49,3	31,2	71,4	106,5	183,7	216,2	345,3	331,7	260,0	220,0
4,5	21,2	29,0	53,2	45,9	90,9	135,7	219,5	283,9	451,4	500,2	-	-
5,0	22,4	32,2	57,5	65,0	107,4	160,9	247,1	341,2	543,3	634,1	400,2	455,2
5,5	-	-	64,4	79,5	121,6	182,1	273,3	387,7	622,0	733,2	-	-
6,0	-	-	71,8	89,3	135,0	201,9	298,2	430,1	694,0	825,1	670,1	724,4
6,5	-	-	76,6	96,6	148,1	221,6	321,3	471,7	765,2	922,9	-	-
7,0	-	-	80,4	102,7	159,9	239,8	342,2	507,6	823,7	1018	967	1090
7,5	-	-	84,1	108,2	169,8	255,9	360,7	535,2	876,3	1100	-	-
8,0	-	-	88,8	113,4	177,9	270,8	376,8	560,8	925,3	1170	1190	1398
8,5	-	-	-	-	184,7	285,1	390,2	590,0	974,4	1230	-	-
9,0	-	-	-	-	-	-	-	619,3	1022	1285	1344	1620
9,5	-	-	-	-	-	-	-	644,9	1068	1340	-	-
10,0	-	-	-	-	-	-	-	667,2	1110	1394	1490	1820
10,5	-	-	-	-	-	-	-	688,4	1150	1449	-	-
11,0	-	-	-	-	-	-	-	710,0	1188	1504	1610	2000
12,0	-	-	-	-	-	-	-	-	-	-	1712	2168
13,0	-	-	-	-	-	-	-	-	-	-	1810	2320
14,0	-	-	-	-	-	-	-	-	-	-	1910	2440
15,0	-	-	-	-	-	-	-	-	-	-	1992	2560
16,0	-	-	-	-	-	-	-	-	-	-	2070	2672
17,0	-	-	-	-	-	-	-	-	-	-	2140	2770
18,0	-	-	-	-	-	-	-	-	-	-	2215	2860
19,0	-	-	-	-	-	-	-	-	-	-	-	2950
20,0	-	-	-	-	-	-	-	-	-	-	-	3023
21,0	-	-	-	-	-	-	-	-	-	-	-	3090
22,0	-	-	-	-	-	-	-	-	-	-	-	3150
23,0	-	-	-	-	-	-	-	-	-	-	-	3200
24,0	-	-	-	-	-	-	-	-	-	-	-	3262

Copy of the table presented in flow measurement paragraph  
 $\Delta p$  (headloss) approximately equal to  $\Delta p^{TP}$

## INSTALLATION

To obtain the best performances valve must be installed on a pipe with its same nominal size preceded and followed by straight pipe lengths as per figure indications.

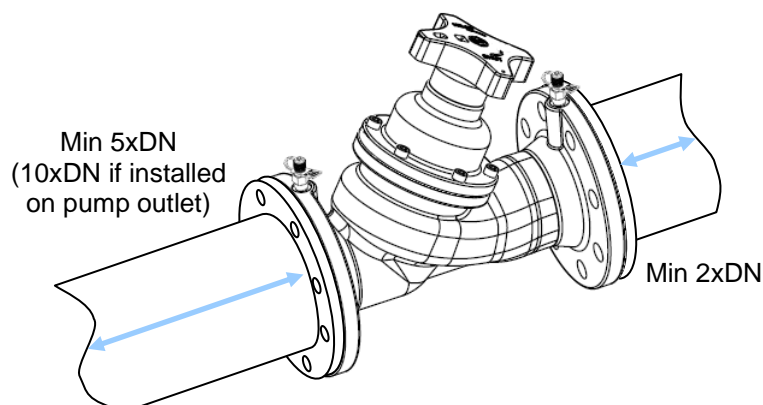

Via Circonvallazione, 10  
 13018 Valduggia (VC), Italy  
 Tel: +39 0163 47891  
 Fax: +39 0163 47895  
[www.vironline.com](http://www.vironline.com)